

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-15/0514
of 15 September 2021

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

TSM high performance, TSM high performance A4,
TSM high performance HCR

Product family
to which the construction product belongs

Mechanical fasteners for use in concrete

Manufacturer

TOGE Dübel GmbH & Co. KG
Illesheimer Straße 10
90431 Nürnberg
DEUTSCHLAND

Manufacturing plant

TOGE Dübel GmbH & Co. KG

This European Technical Assessment
contains

22 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330232-00-0601, Edition 10/2016

This version replaces

ETA-15/0514 issued on 22 September 2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The TOGE Concrete screw TSM high performance is an anchor in size 6, 8, 10, 12 and 14 mm made of galvanised steel respectively steel with zinc flake coating, made of stainless or high corrosion resistant steel. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

Product and product description are given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|--|---------------------------------|
| Characteristic resistance to tension load (static and quasi-static loading) | See Annex C 1 and C 2 |
| Characteristic resistance to shear load (static and quasi-static loading) | See Annex C 1 and C 2 |
| Displacements (static and quasi-static loading) | See Annex C 7 |
| Characteristic resistance and displacements for seismic performance categories C1 and C2 | See Annex C 3, C 4, C 5 and C 8 |
| Durability | See Annex B 1 |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance |
|--------------------------|---------------|
| Reaction to fire | Class A1 |
| Resistance to fire | See Annex C 6 |

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330232-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 15 September 2021 by Deutsches Institut für Bautechnik


Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Tempel


Product in installed condition

TOGE concrete screw TSM high performance


- Galvanized carbon steel
- Zinc flakes coated carbon steel

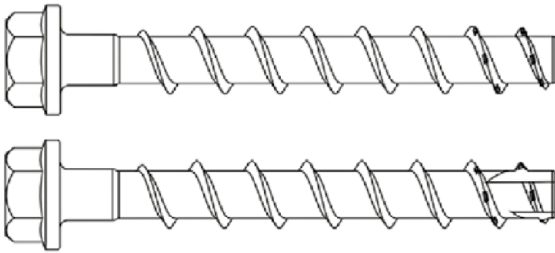

- Stainless steel A4
- Stainless steel HCR




e.g. TOGE concrete screw, zinc flakes coated, with hexagon head and fixture

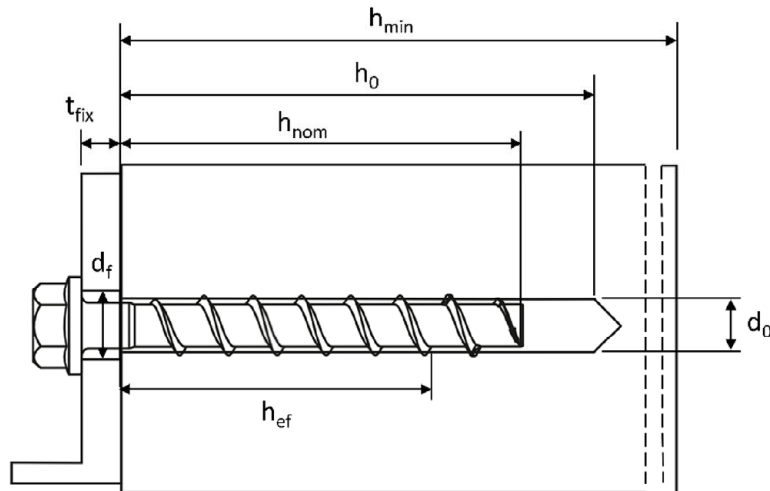

d_0 = nominal drill hole diameter
 t_{fix} = thickness of fixture
 d_f = clearance hole diameter

h_{min} = minimum thickness of member
 h_{nom} = nominal embedment depth
 h_0 = drill hole depth
 h_{ef} = effective embedment depth

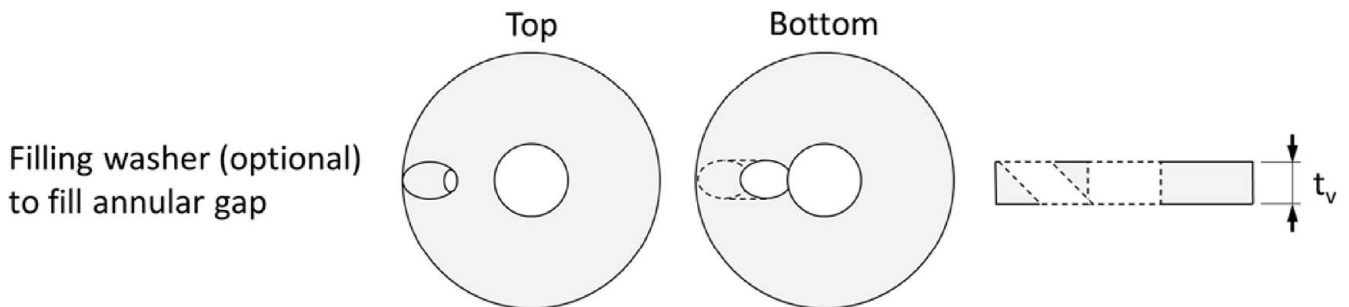

























Filling washer (optional)
to fill annular gap

TOGE concrete screw TSM high performance

Product description
Product in installed condition

Annex A1

| | | |
|---|---|--|
|  |  | Configuration with metric connection thread and hexagon socket e.g. TSM 8x105 M10 SW5; Type ST |
|  |  | Configuration with metric connection thread and hexagon drive e.g. TSM 8x105 M10 SW7; Type ST |
|  |  | Configuration with washer and hexagon head e.g. TSM 8x80 SW13 VZ 40; Type S |
|  |  | Configuration with washer, hexagon head and TORX drive e.g. TSM 8x80 SW13; Type S |
|  |  | Configuration with washer and bund e.g. TSM BC ST 14x130 SW24 VZ 40; Type BND |
|  |  | Configuration with hexagon head e.g. TSM 8x80 SW13 OS; Type S |
|  |  | Configuration with countersunk head and TORX drive e.g. TSM 8x80 C VZ 40; Type SK |
|  |  | Configuration with pan head and TORX drive e.g. TSM 8x80 P VZ 40; Type P |
|  |  | Configuration with large pan head and TORX drive e.g. TSM 8x80 LP VZ 40; Type P |
|  |  | Configuration with countersunk head and connection thread e.g. TSM 6x55 AG M8; Type ST-6 |
|  |  | Configuration with hexagon drive and connection thread e.g. TSM 6x55 M8 SW10; Type ST-6 |
|  |  | Configuration with internal thread and hexagon drive e.g. TSM 6x55 IM M8/10; Type I |

TOGE concrete screw TSM high performance

Product description
Screw types

Annex A2

Table 1: Material

| Part | Product name | Material | | |
|-----------|--------------------------|--|-------------------------------|--------------------|
| all types | TSM high performance | - Steel EN 10263-4:2017 galvanized acc. to EN ISO 4042:2018 - Zinc flake coating according to EN ISO 10683:2018 ($\geq 5\mu\text{m}$) - Zinc flake coating according to EN ISO 10683:2018 special coating TOGE KORR ($\geq 20\mu\text{m}$) | | |
| | TSM high performance A4 | 1.4401; 1.4404; 1.4571; 1.4578 | | |
| | TSM high performance HCR | 1.4529 | | |
| Part | Product name | Nominal characteristic steel | | Rupture elongation |
| | | Yield strength | Ultimate strength | A_5 [%] |
| | | f_{yk} [N/mm ²] | f_{uk} [N/mm ²] | |
| all types | TSM high performance | 560 | 700 | ≤ 8 |
| | TSM high performance A4 | | | |
| | TSM high performance HCR | | | |

Table 2: Dimensions

| Anchor size | | | 6 | | 8 | | | 10 | | | 12 | | | 14 | | |
|-----------------------------|-----------|------|-----|----|------|----|----|------|----|----|------|----|----|------|----|-----|
| Nominal embedment depth | h_{nom} | [mm] | 1 | 2 | 1 | 2 | 3 | 1 | 2 | 3 | 1 | 2 | 3 | 1 | 2 | 3 |
| | | | | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | 65 | 85 | 100 | 75 | 100 |
| Screw length | $\leq L$ | [mm] | 500 | | | | | | | | | | | | | |
| Core diameter | d_k | [mm] | 5,1 | | 7,1 | | | 9,1 | | | 11,1 | | | 13,1 | | |
| Thread outer diameter | d_s | [mm] | 7,5 | | 10,6 | | | 12,6 | | | 14,6 | | | 16,6 | | |
| Thickness of filling washer | t_v | [mm] | - | | 5 | | | 5 | | | 5 | | | 5 | | |

Marking:


TSM high performance

Screw type: TSM
Screw size: 10
Screw length: 100



TSM high performance A4

Screw type: TSM
Screw size: 10
Screw length: 100
Material: A4




TSM high performance BC ST

Screw type: TSM BC ST
Screw size: 10
Screw length: 100



TSM high performance HCR

Screw type: TSM
Screw size: 10
Screw length: 100
Material: HCR

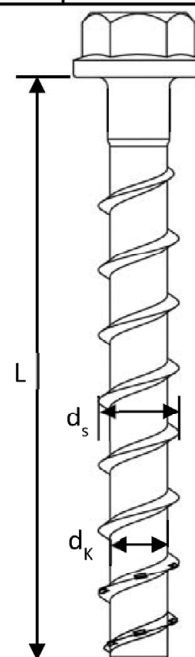

TOGE concrete screw TSM high Performance

Product description
Material, Dimensions and markings

Annex A3

Specification of Intended use

Table 3: Anchorages subject to

| TSM concrete screw size | | 6 | | 8 | | | 10 | | | 12 | | | 14 | | |
|--|------|------------------------------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| Nominal embedment depth | | h_{nom1} | h_{nom2} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| | [mm] | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | 65 | 85 | 100 | 65 | 85 | 115 |
| Static and quasi-static loads | | All sizes and all embedment depths | | | | | | | | | | | | | |
| Fire exposure | | All sizes and all embedment depths | | | | | | | | | | | | | |
| C1 category - seismic | | ok | ok | | | | ok | | | | | | | | |
| C2 category – seismic (A4 and HCR: no performance assessed) | | | | 1) | | ok | 1) | 1) | ok | 1) | | ok | 1) | | ok |

¹⁾ no performance assessed

Base materials:

- Compacted reinforced and unreinforced concrete without fibers according to EN 206:2013.
- Strength classes C20/25 to C50/60 according to EN 206:2013.
- Cracked and uncracked concrete.

Use conditions (Environmental conditions):

- Concrete screws subject to dry internal conditions: all screw types.
- Structural subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition no particular aggressive conditions exists: screw types made of stainless steel with marking A4.
- Structural subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition if particular aggressive conditions exists: screw types made of stainless steel with marking HCR.

Note: Such particular aggressive conditions are e.g. permanent, alternating immersion in seawater or splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

TOGE concrete screw TSM high Performance

Intended use
Specification

Annex B1

Specification of Intended use - continuation

Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed according to EN 1992-4:2018 and EOTA Technical Report TR 055. The design for shear load according to EN 1992-4:2018, Section 6.2.2 applies for all specified diameters d_f of clearance hole in the fixture in Annex B3, Table 4.

Installation:

- Hammer drilling or hollow drilling.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on site.
- In case of aborted hole: new drilling must be drilled at a minimum distance of twice the depth of aborted hole or closer, if the aborted hole is filled with high strength mortar and only if the hole is not in the direction of the oblique tensile or shear load.
- After installation further turning of the anchor must not be possible. The head of the anchor is supported in the fixture and is not damaged.
- The borehole may be filled with injection mortar CF-T 300V or ATA 2004C.
- Adjustability according to Annex B6 for sizes 6-14, all embedment depths except for applications with filled borehole and not for seismic applications.
- Cleaning of borehole is not necessary, if using a hollow drill.

TOGE concrete screw TSM high Performance


Intended use
Specification continuation

Annex B2

Table 4: Installation parameters

| TSM concrete screw size | | 6 | | 8 | | | 10 | | |
|--|----------------|--|------------|------------|------------|------------|------------|------------|------------|
| Nominal embedment depth | h_{nom} | h_{nom1} | h_{nom2} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| | [mm] | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 |
| Nominal drill hole diameter | d_0 | 6 | | 8 | | | 10 | | |
| Cutting diameter of drill bit | $d_{cut} \leq$ | 6,40 | | 8,45 | | | 10,45 | | |
| Drill hole depth | $h_0 \geq$ | 45 | 60 | 55 | 65 | 75 | 65 | 85 | 95 |
| Clearance hole diameter | $d_f \leq$ | 8 | | 12 | | | 14 | | |
| Installation torque (version with connection thread) | T_{inst} | 10 | | 20 | | | 40 | | |
| Torque impact screw driver | [Nm] | Max. torque according to manufacturer's instructions | | | | | | | |
| | | 160 | | 300 | | | 400 | | |

| TSM concrete screw size | | 12 | | | 14 | | |
|--|----------------|--|------------|------------|------------|------------|------------|
| Nominal embedment depth | h_{nom} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| | [mm] | 65 | 85 | 100 | 75 | 100 | 115 |
| Nominal drill hole diameter | d_0 | 12 | | | 14 | | |
| Cutting diameter of drill bit | $d_{cut} \leq$ | 12,50 | | | 14,50 | | |
| Drill hole depth | $h_0 \geq$ | 75 | 95 | 110 | 85 | 110 | 125 |
| Clearance hole diameter | $d_f \leq$ | 16 | | | 18 | | |
| Installation torque (version with connection thread) | T_{inst} | 60 | | | 80 | | |
| Torque impact screw driver | [Nm] | Max. torque according to manufacturer's instructions | | | | | |
| | | 650 | | | 650 | | |

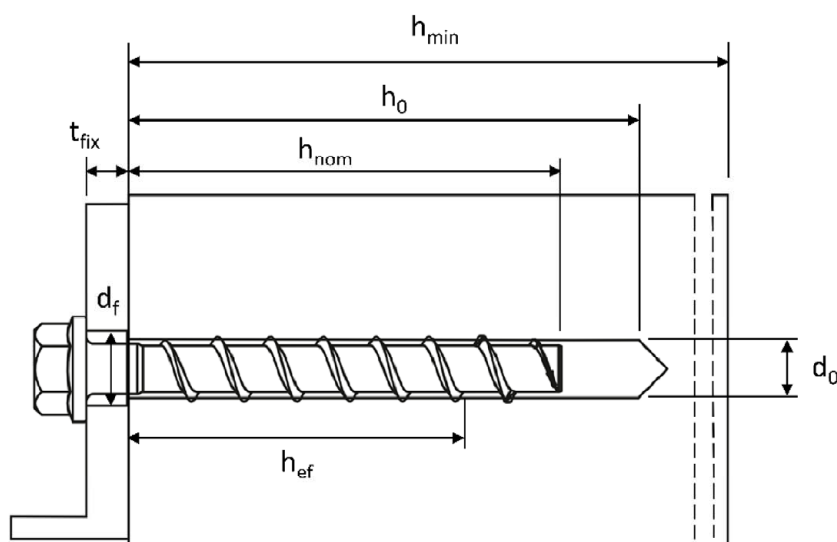

TOGE concrete screw TSM high Performance


Intended use
Installation parameters

Annex B3

Table 5: Minimum thickness of member, minimum edge distance and minimum spacing

| TSM concrete screw size | | 6 | | | 8 | | | 10 | | |
|-----------------------------|-----------|------------|------------|------------|------------|------------|------------|------------|------------|--|
| Nominal embedment depth | h_{nom} | h_{nom1} | h_{nom2} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | |
| | [mm] | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | |
| Minimum thickness of member | h_{min} | [mm] | 100 | 100 | 100 | 120 | 100 | 130 | | |
| Minimum edge distance | c_{min} | [mm] | 40 | 40 | 50 | 50 | 50 | 50 | | |
| Minimum spacing | s_{min} | [mm] | 40 | 40 | 50 | 50 | 50 | 50 | | |

| TSM concrete screw size | | 12 | | | 14 | | | |
|-----------------------------|-----------|------------|------------|------------|------------|------------|------------|-----|
| Nominal embedment depth | h_{nom} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | |
| | [mm] | 65 | 85 | 100 | 75 | 100 | 115 | |
| Minimum thickness of member | h_{min} | [mm] | 120 | 130 | 150 | 130 | 150 | 170 |
| Minimum edge distance | c_{min} | [mm] | 50 | 70 | 50 | 70 | 70 | |
| Minimum spacing | s_{min} | [mm] | 50 | 70 | 50 | 70 | 70 | |

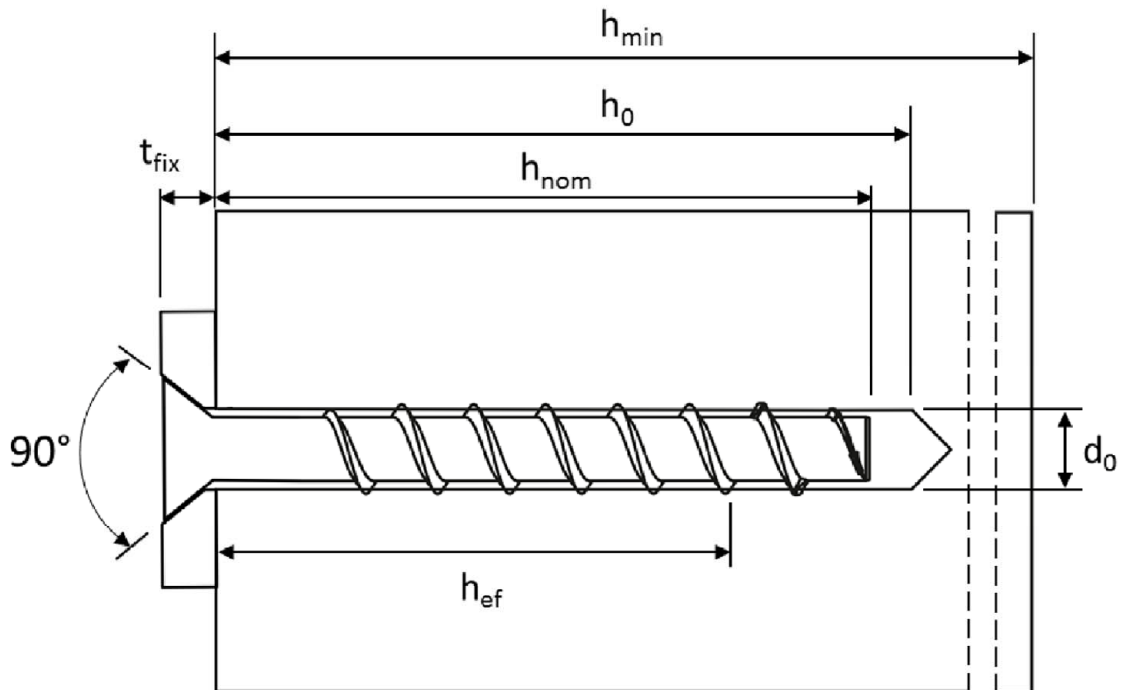





TOGE concrete screw TSM high Performance

Intended use

Minimum thickness of member, minimum edge distance and minimum spacing

Annex B4

Installation Instructions

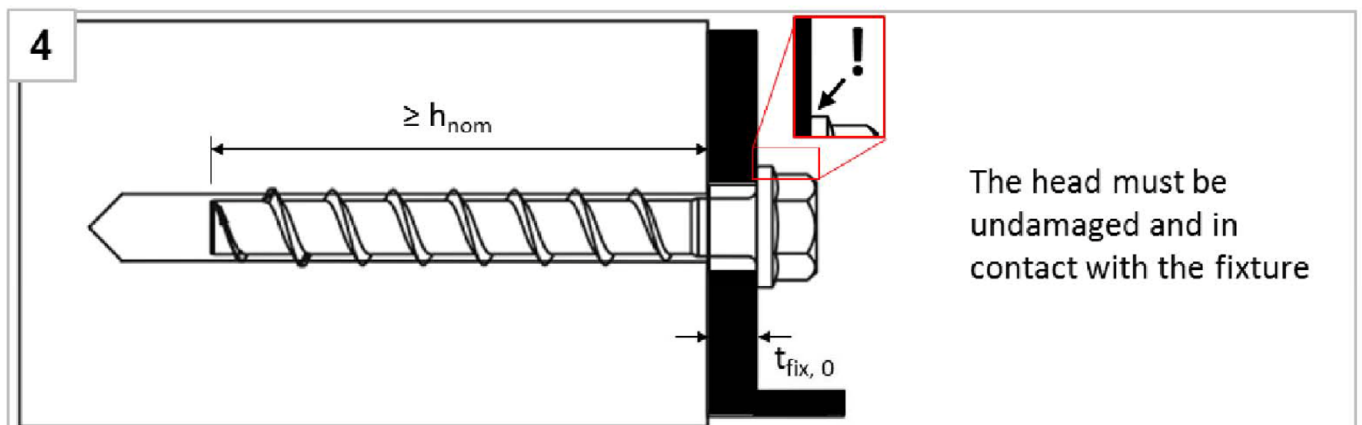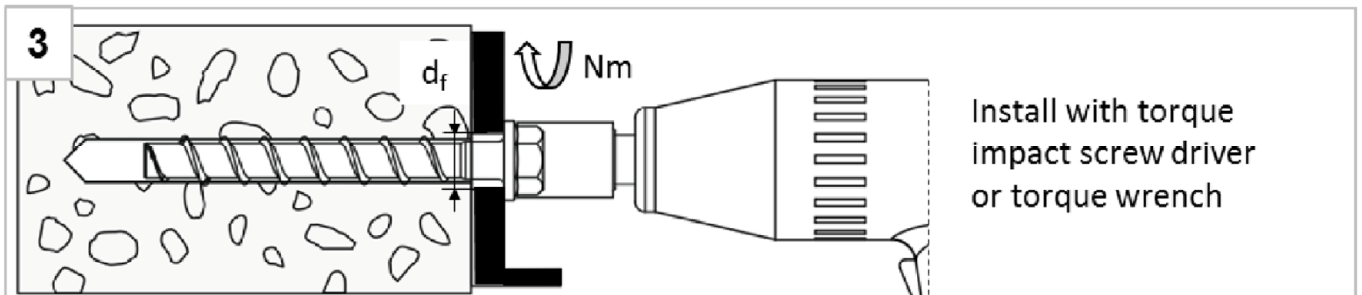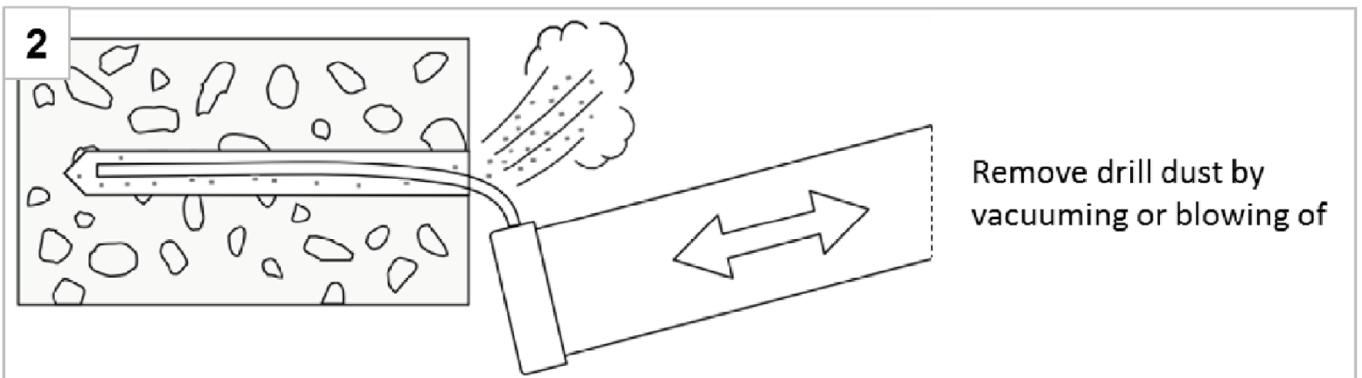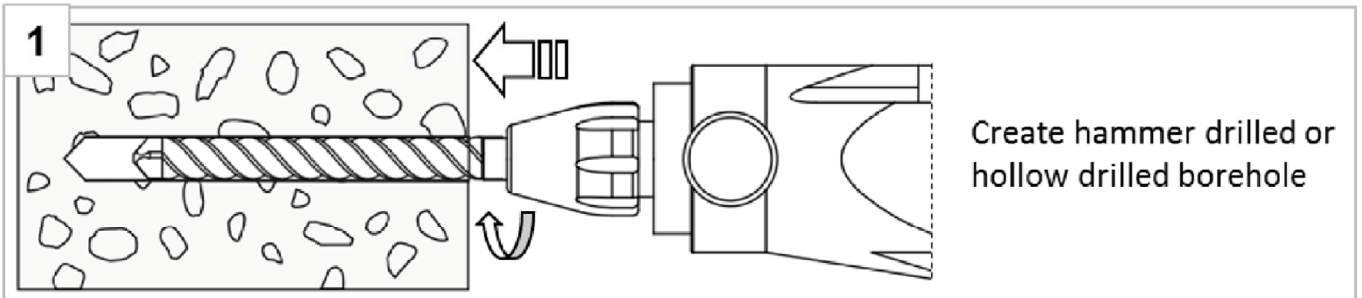

Note:
Cleaning of borehole is not necessary when using a hollow drill


TOGE concrete screw TSM high Performance

Intended use
Installation instructions


Annex B5

Installation Instructions – Adjustment


1. Adjustment

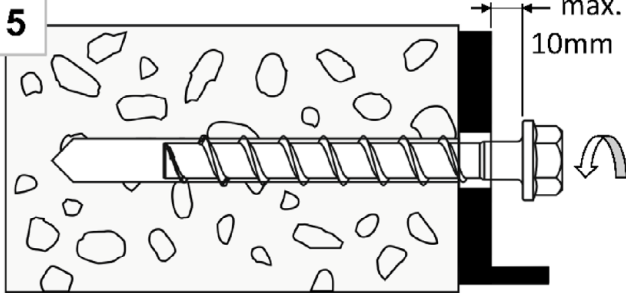

Screw may be untightened maximum 10mm

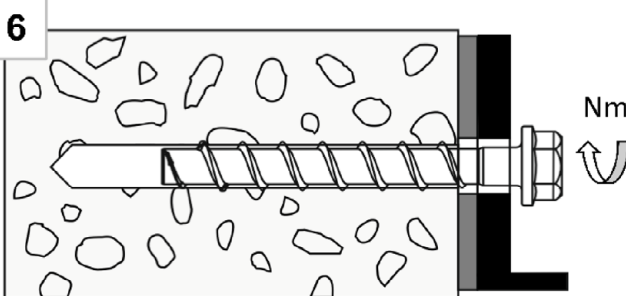


After adjustment, tighten the screw again

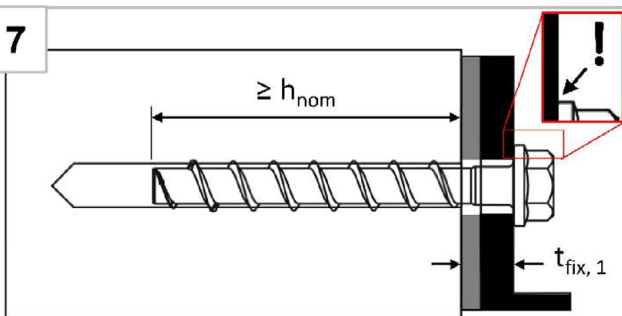


The head must be undamaged and in contact with the fixture


2. Adjustment

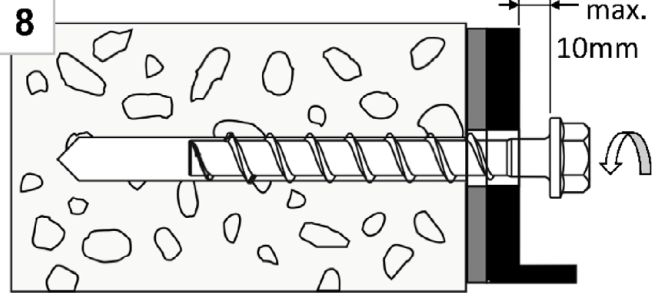

Screw may be untightened maximum 10mm

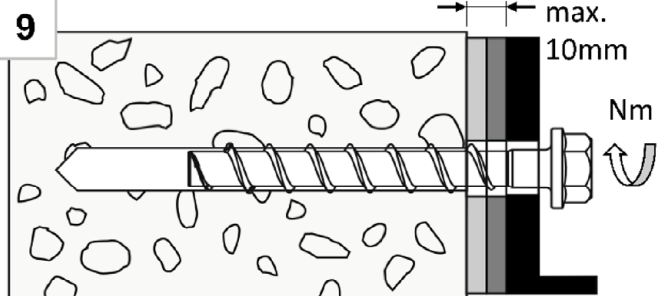

After adjustment, tighten the screw again

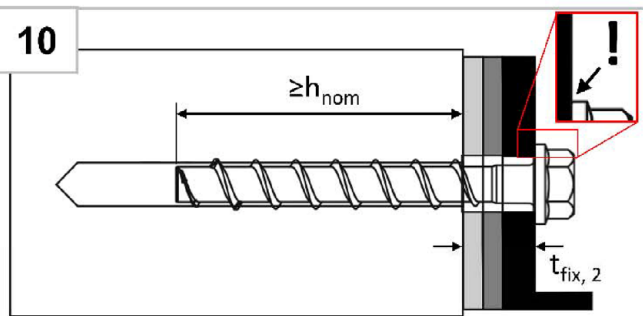

The head must be undamaged and in contact with the fixture

Note:

The fastener can be adjusted maximum two times. The total allowed thickness of shims added during the adjustment process is 10mm. The final embedment depth after adjustment process must be larger or equal than h_{nom} .





TOGE concrete screw TSM high Performance

Intended use
Installation instructions - Adjustment


Annex B6

Installation Instructions – Filling annular gap

Positioning of fixture and filling washer

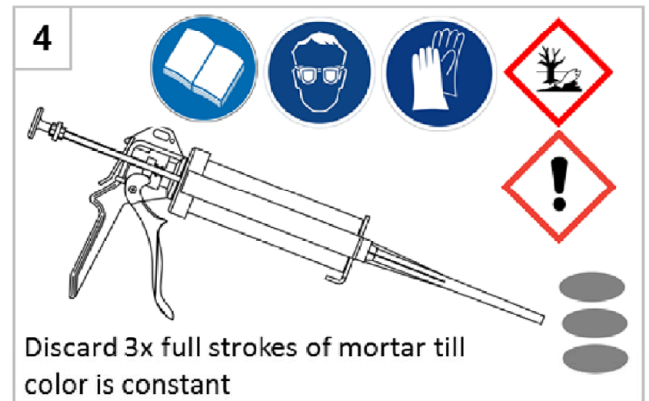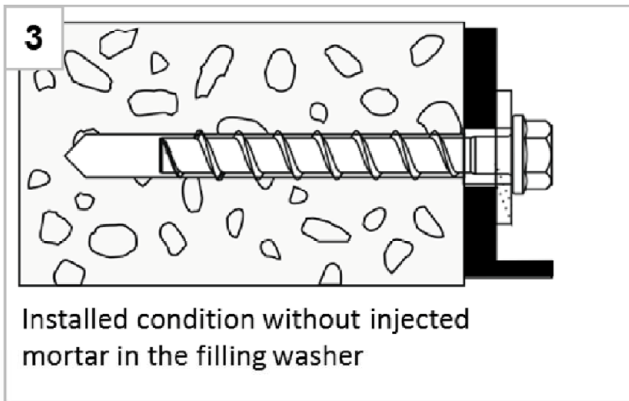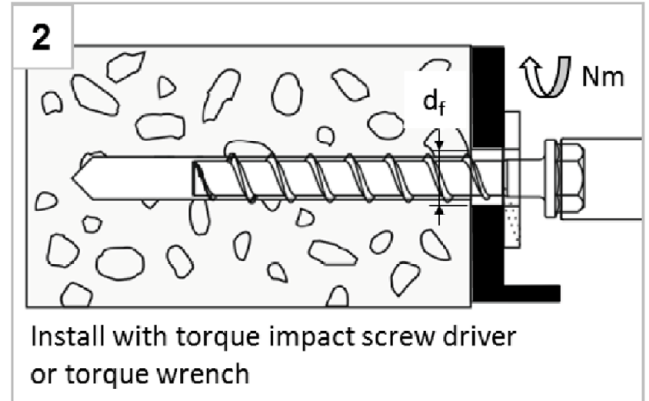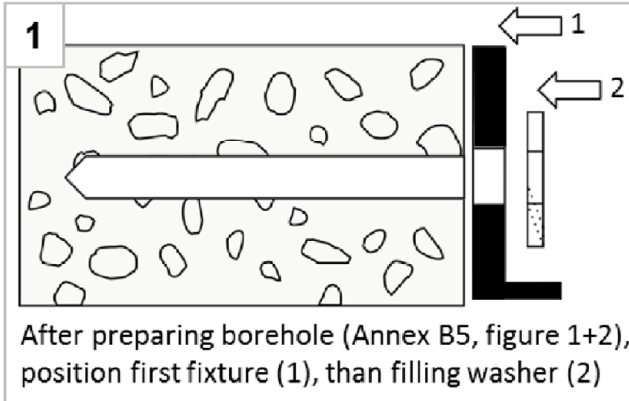

Filling the annular gap

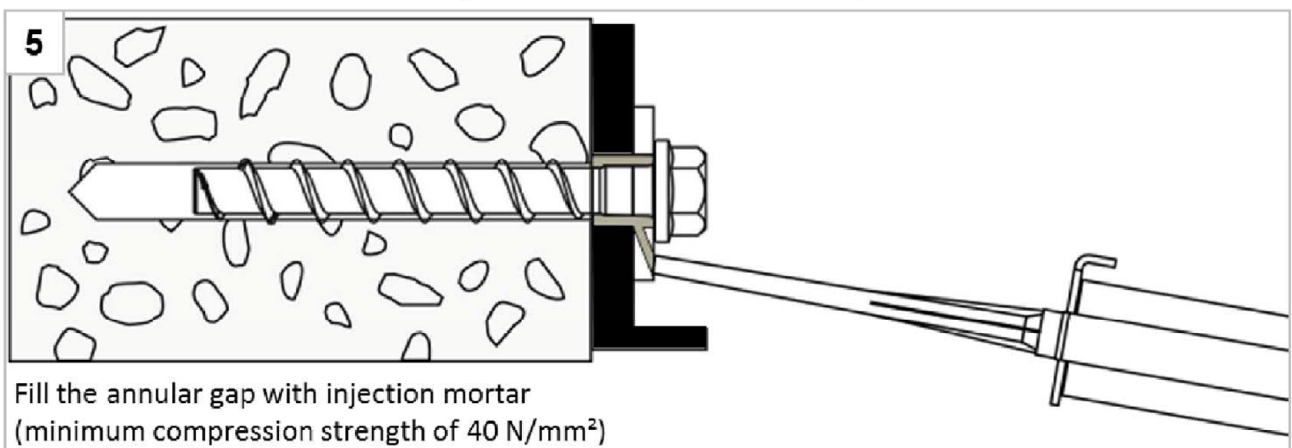

Note:

For seismic loading the installation with filled and without filled annular gap is approved. Differences in performance can be found in Annex C5 - C7.

TOGE concrete screw TSM high Performance

Intended use
Installation instructions - Filling annular gap

Annex B7

Table 6: Characteristic values for static and quasi-static loading, sizes 6-10

| TSM concrete screw size | | | 6 | | | 8 | | | 10 | | |
|--|-----------------|---------------|---------------------|------------|------------|------------|------------|------------|------------|---------------------------------|------|
| Nominal embedment depth | h_{nom} | | h_{nom1} | h_{nom2} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | |
| | [mm] | | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | |
| Steel failure for tension and shear loading | | | | | | | | | | | |
| Characteristic tension load | $N_{RK,S}$ | [kN] | 14,0 | | | 27,0 | | | 45,0 | | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,5 | | | | | | | | |
| Characteristic shear load | $V^0_{RK,S}$ | [kN] | 7,0 | | | 13,5 | | | 17,0 | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | | |
| Ductility factor | k_7 | [-] | 0,8 | | | | | | | | |
| Characteristic bending load | $M^0_{RK,S}$ | [Nm] | 10,9 | | | 26,0 | | | 56,0 | | |
| Pull-out failure | | | | | | | | | | | |
| Characteristic tension load C20/25 | cracked | $N_{RK,p}$ | [kN] | 2,0 | 4,0 | 5,0 | 9,0 | 12,0 | 9,0 | $\geq N^0_{RK,c}$ ¹⁾ | |
| | uncracked | $N_{RK,p}$ | [kN] | 4,0 | 9,0 | 7,5 | 12,0 | 16,0 | 12,0 | 20,0 | 26,0 |
| Increasing factor for $N_{RK,p}$ | C25/30 | Ψ_c | [-] | 1,12 | | | | | | | |
| | C30/37 | | | 1,22 | | | | | | | |
| | C40/50 | | | 1,41 | | | | | | | |
| | C50/60 | | | 1,58 | | | | | | | |
| Concrete failure: Splitting failure, concrete cone failure and pry-out failure | | | | | | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 31 | 44 | 35 | 43 | 52 | 43 | 60 | 68 | |
| k-factor | cracked | k_{cr} | 7,7 | | | | | | | | |
| | uncracked | k_{ucr} | 11,0 | | | | | | | | |
| Concrete cone failure | spacing | $s_{cr,N}$ | $3 \times h_{ef}$ | | | | | | | | |
| | edge distance | $c_{cr,N}$ | $1,5 \times h_{ef}$ | | | | | | | | |
| Splitting failure | resistance | $N^0_{RK,sp}$ | [kN] | 4,0 | 9,0 | 7,5 | 12,0 | 16,0 | 12,0 | 20,0 | 26,0 |
| | spacing | $s_{cr,sp}$ | [mm] | 120 | 160 | 120 | 140 | 150 | 140 | 180 | 210 |
| | edge distance | $c_{cr,sp}$ | [mm] | 60 | 80 | 60 | 70 | 75 | 70 | 90 | 105 |
| Factor for pry-out failure | k_8 | [-] | 1,0 | | | | | | 2,0 | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | |
| Effective length in concrete | $l_f = h_{ef}$ | [mm] | 31 | 44 | 35 | 43 | 52 | 43 | 60 | 68 | |
| Nominal outer diameter of screw | d_{nom} | [mm] | 6 | | | 8 | | | 10 | | |
| ¹⁾ $N^0_{RK,c}$ according to EN 1992-4:2018 | | | | | | | | | | | |
| TOGE concrete screw TSM high Performance | | | | | | | | | | Annex C1 | |
| Performances Characteristic values for static and quasi-static loading, sizes 6-10 | | | | | | | | | | | |

Table 7: Characteristic values for static and quasi-static loading, sizes 12-14

| TSM concrete screw size | | | 12 | | | 14 | | | |
|---|-----------------|-----------------|------------|---------------------|---------------------------------|------------|------------|------------|------|
| Nominal embedment depth | h_{nom} | | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | |
| | [mm] | | 65 | 85 | 100 | 75 | 100 | 115 | |
| Steel failure for tension and shear loading | | | | | | | | | |
| Characteristic tension load | $N_{RK,s}$ | [kN] | 67,0 | | | 94,0 | | | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,5 | | | | | | |
| Characteristic shear load | $V^0_{RK,s}$ | [kN] | 33,5 | 42,0 | | 56,0 | | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | |
| Ductility factor | k_7 | [-] | 0,8 | | | | | | |
| Characteristic bending load | $M^0_{RK,s}$ | [Nm] | 113,0 | | | 185,0 | | | |
| Pull-out failure | | | | | | | | | |
| Characteristic tension load C20/25 | cracked | $N_{RK,p}$ | [kN] | 12,0 | $\geq N^0_{RK,c}$ ¹⁾ | | | | |
| | uncracked | $N_{RK,p}$ | [kN] | 16,0 | | | | | |
| Increasing factor for $N_{RK,p}$ | C25/30 | ψ_c | [-] | 1,12 | | | | | |
| | C30/37 | | | 1,22 | | | | | |
| | C40/50 | | | 1,41 | | | | | |
| | C50/60 | | | 1,58 | | | | | |
| Concrete failure: Splitting failure, concrete cone failure and pry-out failure | | | | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 50 | 67 | 80 | 58 | 79 | 92 | |
| k-factor | cracked | $k_1 = k_{cr}$ | [-] | 7,7 | | | | | |
| | uncracked | $k_1 = k_{ucr}$ | [-] | 11,0 | | | | | |
| Concrete cone failure | spacing | $S_{cr,N}$ | [mm] | $3 \times h_{ef}$ | | | | | |
| | edge distance | $C_{cr,N}$ | [mm] | $1,5 \times h_{ef}$ | | | | | |
| Splitting failure | resistance | $N^0_{RK,sp}$ | [kN] | 16,0 | 27,0 | 35,0 | 21,5 | 34,5 | 43,5 |
| | spacing | $S_{cr,sp}$ | [mm] | 150 | 210 | 240 | 180 | 240 | 280 |
| | edge distance | $C_{cr,sp}$ | [mm] | 75 | 105 | 120 | 90 | 120 | 140 |
| Factor for pry-out failure | k_8 | [-] | 1,0 | 2,0 | | 1,0 | 2,0 | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | |
| Concrete edge failure | | | | | | | | | |
| Effective length in concrete | $l_f = h_{ef}$ | [mm] | 50 | 67 | 80 | 58 | 79 | 92 | |
| Nominal outer diameter of screw | d_{nom} | [mm] | 12 | | | 14 | | | |

¹⁾ $N^0_{RK,c}$ according to EN 1992-4:2018

TOGE concrete screw TSM high Performance

Performances

Characteristic values for static and quasi-static loading, sizes 12-14

Annex C2

Table 8: Seismic category C1 – Characteristic load values (type S, type SK, type ST, type ST-6¹⁾, type P and type I¹⁾)

| TSM concrete screw size | | | 6 | 8 | 10 | 12 | 14 | | |
|--|------------------|------------|----------------|------------|------------|------------|---------------------------------|------|------|
| Nominal embedment depth | h_{nom} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom3} | h_{nom3} | | |
| | [mm] | 40 | 55 | 65 | 55 | 85 | 100 | 115 | |
| Steel failure for tension and shear load (version type S, type SK, type ST, type ST-6¹⁾, type P, type I¹⁾) | | | | | | | | | |
| Characteristic load | $N_{Rk,s,eq}$ | [kN] | 14,0 | 27,0 | 45,0 | 67,0 | 94,0 | | |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,5 | | | | | | |
| Characteristic load | $V_{Rk,s,eq}$ | [kN] | 4,7 | 5,5 | 8,5 | 13,5 | 15,3 | 21,0 | 22,4 |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,25 | | | | | | |
| With filling of the annular gap ²⁾ | α_{gap} | [-] | 1,0 | | | | | | |
| Without filling of the annular gap ³⁾ | α_{gap} | [-] | 0,5 | | | | | | |
| Pull-out failure (version type S, type SK, type ST, type ST-6¹⁾, type P, type I¹⁾) | | | | | | | | | |
| Characteristic tension load in cracked concrete C20/25 | $N_{Rk,p,eq}$ | [kN] | 2,0 | 4,0 | 12,0 | 9,0 | $\geq N_{Rk,c}^0$ ⁴⁾ | | |
| Concrete cone failure (version type S, type SK, type ST, type ST-6¹⁾, type P, type I¹⁾) | | | | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 31 | 44 | 52 | 43 | 68 | 80 | 92 |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 x h_{ef} | | | | | | |
| Spacing | $s_{cr,N}$ | [mm] | 3 x h_{ef} | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | | | | |
| Concrete pry-out failure (version type S, type SK, type ST, type P) | | | | | | | | | |
| Factor for pry-out failure | k_8 | [-] | 1,0 | | | 2,0 | | | |
| Concrete edge failure (version type S, type SK, type ST, type P) | | | | | | | | | |
| Effective length in concrete | $l_f = h_{ef}$ | [mm] | 31 | 44 | 52 | 43 | 68 | 80 | 92 |
| Nominal outer diameter of screw | d_{nom} | [mm] | 6 | 6 | 8 | 10 | 10 | 12 | 14 |
| ¹⁾ only tension load ²⁾ With filling of the annular gap according to annex B7, figure 5 ³⁾ Without filling of the annular gap according to annex B5 ⁴⁾ $N_{Rk,c}^0$ according to EN 1992-4:2018 | | | | | | | | | |
| TOGE concrete screw TSM high Performance | | | | | | | Annex C3 | | |
| Performances Seismic category C1 – Characteristic load values | | | | | | | | | |

Table 9: Seismic category C2 ¹⁾ – Characteristic load values with filled annular gap according to annex B7, figure 5 (type S, type ST, type P)

| | | | | | | |
|---|------------------|------------|---------------------|------|------|------|
| TSM concrete screw size | | | 8 | 10 | 12 | 14 |
| Nominal embedment depth | h_{nom} | h_{nom3} | | | | |
| | [mm] | 65 | 85 | 100 | 115 | |
| Steel failure for tension and shear load (version type S, type ST, type P) | | | | | | |
| Characteristic load | $N_{RK,s,eq}$ | [kN] | 27,0 | 45,0 | 67,0 | 94,0 |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,5 | | | |
| Characteristic load | $V_{RK,s,eq}$ | [kN] | 9,9 | 18,5 | 31,6 | 40,7 |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,25 | | | |
| With filling of the annular gap | α_{gap} | [-] | 1,0 | | | |
| Pull-out failure (version type S, type ST, type P) | | | | | | |
| Characteristic load in cracked concrete | $N_{RK,p,eq}$ | [kN] | 2,4 | 5,4 | 7,1 | 10,5 |
| Concrete cone failure (version type S, type ST, type P) | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 52 | 68 | 80 | 92 |
| Edge distance | $c_{cr,N}$ | [mm] | $1,5 \times h_{ef}$ | | | |
| Spacing | $s_{cr,N}$ | [mm] | $3 \times h_{ef}$ | | | |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | |
| Concrete pry-out failure (version type S, type ST, type P) | | | | | | |
| Factor for pry-out failure | k_g | [-] | 1,0 | 2,0 | | |
| Concrete edge failure (version type S, type ST, type P) | | | | | | |
| Effective length in concrete | $l_f = h_{ef}$ | [mm] | 52 | 68 | 80 | 92 |
| Nominal outer diameter of screw | d_{nom} | [mm] | 8 | 10 | 12 | 14 |

1) A4 and HCR not suitable

TOGE concrete screw TSM high Performance

Performances

Seismic category C2 – Characteristic load values with filled annular gap

Annex C4

Table 10: Seismic category C2 ¹⁾ – Characteristic load values **without filled annular gap according to annex B5** (type S, type ST, type P)

| | | | | | | |
|---|------------------|------------|---------------------|------|-------------------------|------|
| TSM concrete screw size | | | 8 | 10 | 12 | 14 |
| Nominal embedment depth | h_{nom} | h_{nom3} | | | | |
| | [mm] | 65 | 85 | 100 | 115 | |
| Steel failure for tension and shear load (version type S, type ST, type P) | | | | | | |
| Characteristic load | $N_{Rk,s,eq}$ | [kN] | 27,0 | 45,0 | 67,0 | 94,0 |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,5 | | | |
| Characteristic load | $V_{Rk,s,eq}$ | [kN] | 10,3 | 21,9 | 24,4 | 23,3 |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,25 | | | |
| Without filling of the annular gap | α_{gap} | [-] | 0,5 | | | |
| Pull-out failure (version type S, type ST, type P) | | | | | | |
| Characteristic load in cracked concrete | $N_{Rk,p,eq}$ | [kN] | 2,4 | 5,4 | 7,1 | 10,5 |
| Steel failure for tension and shear load (version type SK) | | | | | | |
| Characteristic load | $N_{Rk,s,eq}$ | [kN] | 27,0 | 45,0 | no performance assessed | |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,5 | | | |
| Characteristic load | $V_{Rk,s,eq}$ | [kN] | 3,6 | 13,7 | | |
| Partial factor | $\gamma_{Ms,eq}$ | [-] | 1,25 | | | |
| Without filling of the annular gap | α_{gap} | [-] | 0,5 | | | |
| Pull-out failure (version type SK) | | | | | | |
| Characteristic load in cracked concrete | $N_{Rk,p,eq}$ | [kN] | 2,4 | 5,4 | no performance assessed | |
| Concrete cone failure (version type S, type SK, type ST, type P) | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 52 | 68 | 80 | 92 |
| Edge distance | $c_{cr,N}$ | [mm] | $1,5 \times h_{ef}$ | | | |
| Spacing | $s_{cr,N}$ | [mm] | $3 \times h_{ef}$ | | | |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | |
| Concrete pry-out failure (version type S, type SK, type ST, type P) | | | | | | |
| Factor for pry-out failure | k_g | [-] | 1,0 | 2,0 | | |
| Concrete edge failure (version type S, type SK, type ST, type P) | | | | | | |
| Effective length in concrete | $l_f = h_{ef}$ | [mm] | 52 | 68 | 80 | 92 |
| Nominal outer diameter of screw | d_{nom} | [mm] | 8 | 10 | 12 | 14 |

¹⁾ A4 and HCR not suitable

TOGE concrete screw TSM high Performance

Performances

Seismic category C2 – Characteristic load values without filled annular gap

Annex C5

Table 11: Fire exposure – characteristic values of resistance

| TSM concrete screw size | | | | 6 | | 8 | | | 10 | | | 12 | | | 14 | | | | | |
|---|--------------------|--------------------------------------|---------------------|------------------|-----|-----|-----|-----|-----|-----|-----|------|-----|-----|-----------------|-----|------|-----|--|--|
| Nominal embedment depth | | | | h _{nom} | 1 | 2 | 1 | 2 | 3 | 1 | 2 | 3 | 1 | 2 | 3 | 1 | 2 | 3 | | |
| | | | | [mm] | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | 65 | 85 | 100 | 75 | 100 | 115 | | |
| Steel failure for tension and shear load | | | | | | | | | | | | | | | | | | | | |
| characteristic Resistance | R30 | N _{Rk,s,fi30} | [kN] | 0,9 | | 2,4 | | | 4,4 | | | 7,3 | | | 10,3 | | | | | |
| | R60 | N _{Rk,s,fi60} | [kN] | 0,8 | | 1,7 | | | 3,3 | | | 5,8 | | | 8,2 | | | | | |
| | R90 | N _{Rk,s,fi90} | [kN] | 0,6 | | 1,1 | | | 2,3 | | | 4,2 | | | 5,9 | | | | | |
| | R120 | N _{Rk,s,fi120} | [kN] | 0,4 | | 0,7 | | | 1,7 | | | 3,4 | | | 4,8 | | | | | |
| | R30 | V _{Rk,s,fi30} | [kN] | 0,9 | | 2,4 | | | 4,4 | | | 7,3 | | | 10,3 | | | | | |
| | R60 | V _{Rk,s,fi60} | [kN] | 0,8 | | 1,7 | | | 3,3 | | | 5,8 | | | 8,2 | | | | | |
| | R90 | V _{Rk,s,fi90} | [kN] | 0,6 | | 1,1 | | | 2,3 | | | 4,2 | | | 5,9 | | | | | |
| | R120 | V _{Rk,s,fi120} | [kN] | 0,4 | | 0,7 | | | 1,7 | | | 3,4 | | | 4,8 | | | | | |
| | R30 | M ⁰ _{Rk,s,fi30} | [Nm] | 0,7 | | 2,4 | | | 5,9 | | | 12,3 | | | 20,4 | | | | | |
| | R60 | M ⁰ _{Rk,s,fi60} | [Nm] | 0,6 | | 1,8 | | | 4,5 | | | 9,7 | | | 15,9 | | | | | |
| | R90 | M ⁰ _{Rk,s,fi90} | [Nm] | 0,5 | | 1,2 | | | 3,0 | | | 7,0 | | | 11,6 | | | | | |
| | R120 | M ⁰ _{Rk,s,fi120} | [Nm] | 0,3 | | 0,9 | | | 2,3 | | | 5,7 | | | 9,4 | | | | | |
| Pull-out failure | | | | | | | | | | | | | | | | | | | | |
| Characteristic Resistance | R30- R90 | N _{Rk,p,fi} | [kN] | 0,5 | 1,0 | 1,3 | 2,3 | 3,0 | 2,3 | 4,0 | 4,8 | 3,0 | 4,7 | 6,2 | 3,8 | 6,0 | 7,6 | | | |
| | R120 | N _{Rk,p,fi} | [kN] | 0,4 | 0,8 | 1,0 | 1,8 | 2,4 | 1,8 | 3,2 | 3,9 | 2,4 | 3,8 | 4,9 | 3,0 | 4,8 | 6,1 | | | |
| Concrete cone failure | | | | | | | | | | | | | | | | | | | | |
| Characteristic Resistance | R30- R90 | N ⁰ _{Rk,c,fi} | [kN] | 0,9 | 2,2 | 1,2 | 2,1 | 3,4 | 2,1 | 4,8 | 6,6 | 3,0 | 6,3 | 9,9 | 4,4 | 9,6 | 14,0 | | | |
| | R120 | N ⁰ _{Rk,c,fi} | [kN] | 0,7 | 1,8 | 1,0 | 1,7 | 2,7 | 1,7 | 3,8 | 5,3 | 2,4 | 5,1 | 7,9 | 3,5 | 7,6 | 11,2 | | | |
| Edge distance | | | | | | | | | | | | | | | | | | | | |
| R30 bis R120 | c _{cr,fi} | [mm] | 2 x h _{ef} | | | | | | | | | | | | | | | | | |
| In case of fire attack from more than one side, the minimum edge distance shall be ≥300mm. | | | | | | | | | | | | | | | | | | | | |
| Spacing | | | | | | | | | | | | | | | | | | | | |
| R30 bis R120 | s _{cr,fi} | [mm] | 4 x h _{ef} | | | | | | | | | | | | | | | | | |
| Pry-out failure | | | | | | | | | | | | | | | | | | | | |
| R30 bis R120 | k _g | [-] | 1,0 | | | 2,0 | | | 1,0 | | | 2,0 | | | 1,0 | | | 2,0 | | |
| The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given value. | | | | | | | | | | | | | | | | | | | | |
| TOGE concrete screw TSM high Performance | | | | | | | | | | | | | | | Annex C6 | | | | | |
| Performances Fire exposure – characteristic values of resistance | | | | | | | | | | | | | | | | | | | | |

Table 12: Displacements under static and quasi-static tension load

| TSM concrete screw size | | | | 6 | | | 8 | | | 10 | | |
|-------------------------|--------------|--------------------|-----------|------------|------------|------------|------------|------------|------------|------------|------------|--|
| Nominal embedment depth | | | h_{nom} | h_{nom1} | h_{nom2} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | |
| | | | [mm] | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | |
| Cracked concrete | tension load | N | [kN] | 0,95 | 1,9 | 2,4 | 4,3 | 5,7 | 4,3 | 7,9 | 9,6 | |
| | displacement | δ_{N0} | [mm] | 0,3 | 0,6 | 0,6 | 0,7 | 0,8 | 0,6 | 0,5 | 0,9 | |
| | | $\delta_{N\infty}$ | [mm] | 0,4 | 0,4 | 0,6 | 1,0 | 0,9 | 0,4 | 1,2 | 1,2 | |
| Uncracked concrete | tension load | N | [kN] | 1,9 | 4,3 | 3,6 | 5,7 | 7,6 | 5,7 | 9,5 | 11,9 | |
| | displacement | δ_{N0} | [mm] | 0,4 | 0,6 | 0,7 | 0,9 | 0,5 | 0,7 | 1,1 | 1,0 | |
| | | $\delta_{N\infty}$ | [mm] | 0,4 | 0,4 | 0,6 | 1,0 | 0,9 | 0,4 | 1,2 | 1,2 | |

| TSM concrete screw size | | | | 12 | | | 14 | | |
|-------------------------|--------------|--------------------|-----------|------------|------------|------------|------------|------------|------------|
| Nominal embedment depth | | | h_{nom} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| | | | [mm] | 65 | 85 | 100 | 75 | 100 | 115 |
| Cracked concrete | tension load | N | [kN] | 5,7 | 9,4 | 12,3 | 7,6 | 12,0 | 15,1 |
| | displacement | δ_{N0} | [mm] | 0,9 | 0,5 | 1,0 | 0,5 | 0,8 | 0,7 |
| | | $\delta_{N\infty}$ | [mm] | 1,0 | 1,2 | 1,2 | 0,9 | 1,2 | 1,0 |
| Uncracked concrete | tension load | N | [kN] | 7,6 | 13,2 | 17,2 | 10,6 | 16,9 | 21,2 |
| | displacement | δ_{N0} | [mm] | 1,0 | 1,1 | 1,2 | 0,9 | 1,2 | 0,8 |
| | | $\delta_{N\infty}$ | [mm] | 1,0 | 1,2 | 1,2 | 0,9 | 1,2 | 1,0 |

Table 13: Displacements under static and quasi-static shear load

| TSM concrete screw size | | | | 6 | | | 8 | | | 10 | | |
|--------------------------------|--------------|--------------------|-----------|------------|------------|------------|------------|------------|------------|------------|------------|--|
| Nominal embedment depth | | | h_{nom} | h_{nom1} | h_{nom2} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | |
| | | | [mm] | 40 | 55 | 45 | 55 | 65 | 55 | 75 | 85 | |
| Cracked and uncracked concrete | shear load | V | [kN] | 3,3 | | | 8,6 | | | 16,2 | | |
| | displacement | δ_{V0} | [mm] | 1,55 | | | 2,7 | | | 2,7 | | |
| | | $\delta_{V\infty}$ | [mm] | 3,1 | | | 4,1 | | | 4,3 | | |

| TSM concrete screw size | | | | 12 | | | 14 | | |
|--------------------------------|--------------|--------------------|-----------|------------|------------|------------|------------|------------|------------|
| Nominal embedment depth | | | h_{nom} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| | | | [mm] | 65 | 85 | 100 | 75 | 100 | 115 |
| Cracked and uncracked concrete | shear load | V | [kN] | 20,0 | | | 30,5 | | |
| | displacement | δ_{V0} | [mm] | 4,0 | | | 3,1 | | |
| | | $\delta_{V\infty}$ | [mm] | 6,0 | | | 4,7 | | |

TOGE concrete screw TSM high Performance

Performances
Displacements under static and quasi-static loads

Annex C7

Table 14: Seismic category C2 ¹⁾ – Displacements with filled annular gap according to annex B7, figure 5 (type S, type ST, type P)

| | | | | | | |
|--|----------------------|------------|------|------|------|------|
| TSM concrete screw size | | | 8 | 10 | 12 | 14 |
| Nominal embedment depth | h_{nom} | h_{nom3} | | | | |
| | [mm] | 65 | 85 | 100 | 115 | |
| Displacements under tension loads (version type S, type ST, type P) | | | | | | |
| Displacement DLS | $\delta_{N,eq(DLS)}$ | [mm] | 0,66 | 0,32 | 0,57 | 1,16 |
| Displacement ULS | $\delta_{N,eq(ULS)}$ | [mm] | 1,74 | 1,36 | 2,36 | 4,39 |
| Displacements under shear loads (version type S, type ST, type P with hole clearance) | | | | | | |
| Displacement DLS | $\delta_{V,eq(DLS)}$ | [mm] | 1,68 | 2,91 | 1,88 | 2,42 |
| Displacement ULS | $\delta_{V,eq(ULS)}$ | [mm] | 5,19 | 6,72 | 5,37 | 9,27 |

Table 15: Seismic category C2 ¹⁾ – Displacements without filled annular gap according to annex B5 (type S, type SK, type ST, type P)

| | | | | | | |
|--|----------------------|------------|------|------|-------------------------|-------|
| TSM concrete screw size | | | 8 | 10 | 12 | 14 |
| Nominal embedment depth | h_{nom} | h_{nom3} | | | | |
| | [mm] | 65 | 85 | 100 | 115 | |
| Displacements under tension loads (version type S, type ST, type P) | | | | | | |
| Displacement DLS | $\delta_{N,eq(DLS)}$ | [mm] | 0,66 | 0,32 | 0,57 | 1,16 |
| Displacement ULS | $\delta_{N,eq(ULS)}$ | [mm] | 1,74 | 1,36 | 2,36 | 4,39 |
| Displacements under tension loads (version type SK) | | | | | | |
| Displacement DLS | $\delta_{N,eq(DLS)}$ | [mm] | 0,66 | 0,32 | no performance assessed | |
| Displacement ULS | $\delta_{N,eq(ULS)}$ | [mm] | 1,74 | 1,36 | | |
| Displacements under shear loads (version type S, type ST, type P with hole clearance) | | | | | | |
| Displacement DLS | $\delta_{V,eq(DLS)}$ | [mm] | 4,21 | 4,71 | 4,42 | 5,60 |
| Displacement ULS | $\delta_{V,eq(ULS)}$ | [mm] | 7,13 | 8,83 | 6,95 | 12,63 |
| Displacements under shear loads (version type SK with hole clearance) | | | | | | |
| Displacement DLS | $\delta_{V,eq(DLS)}$ | [mm] | 2,51 | 2,98 | no performance assessed | |
| Displacement ULS | $\delta_{V,eq(ULS)}$ | [mm] | 7,76 | 6,25 | | |

¹⁾ A4 and HCR not suitable

TOGE concrete screw TSM high Performance

Performances
Displacements under seismic loads

Annex C8